


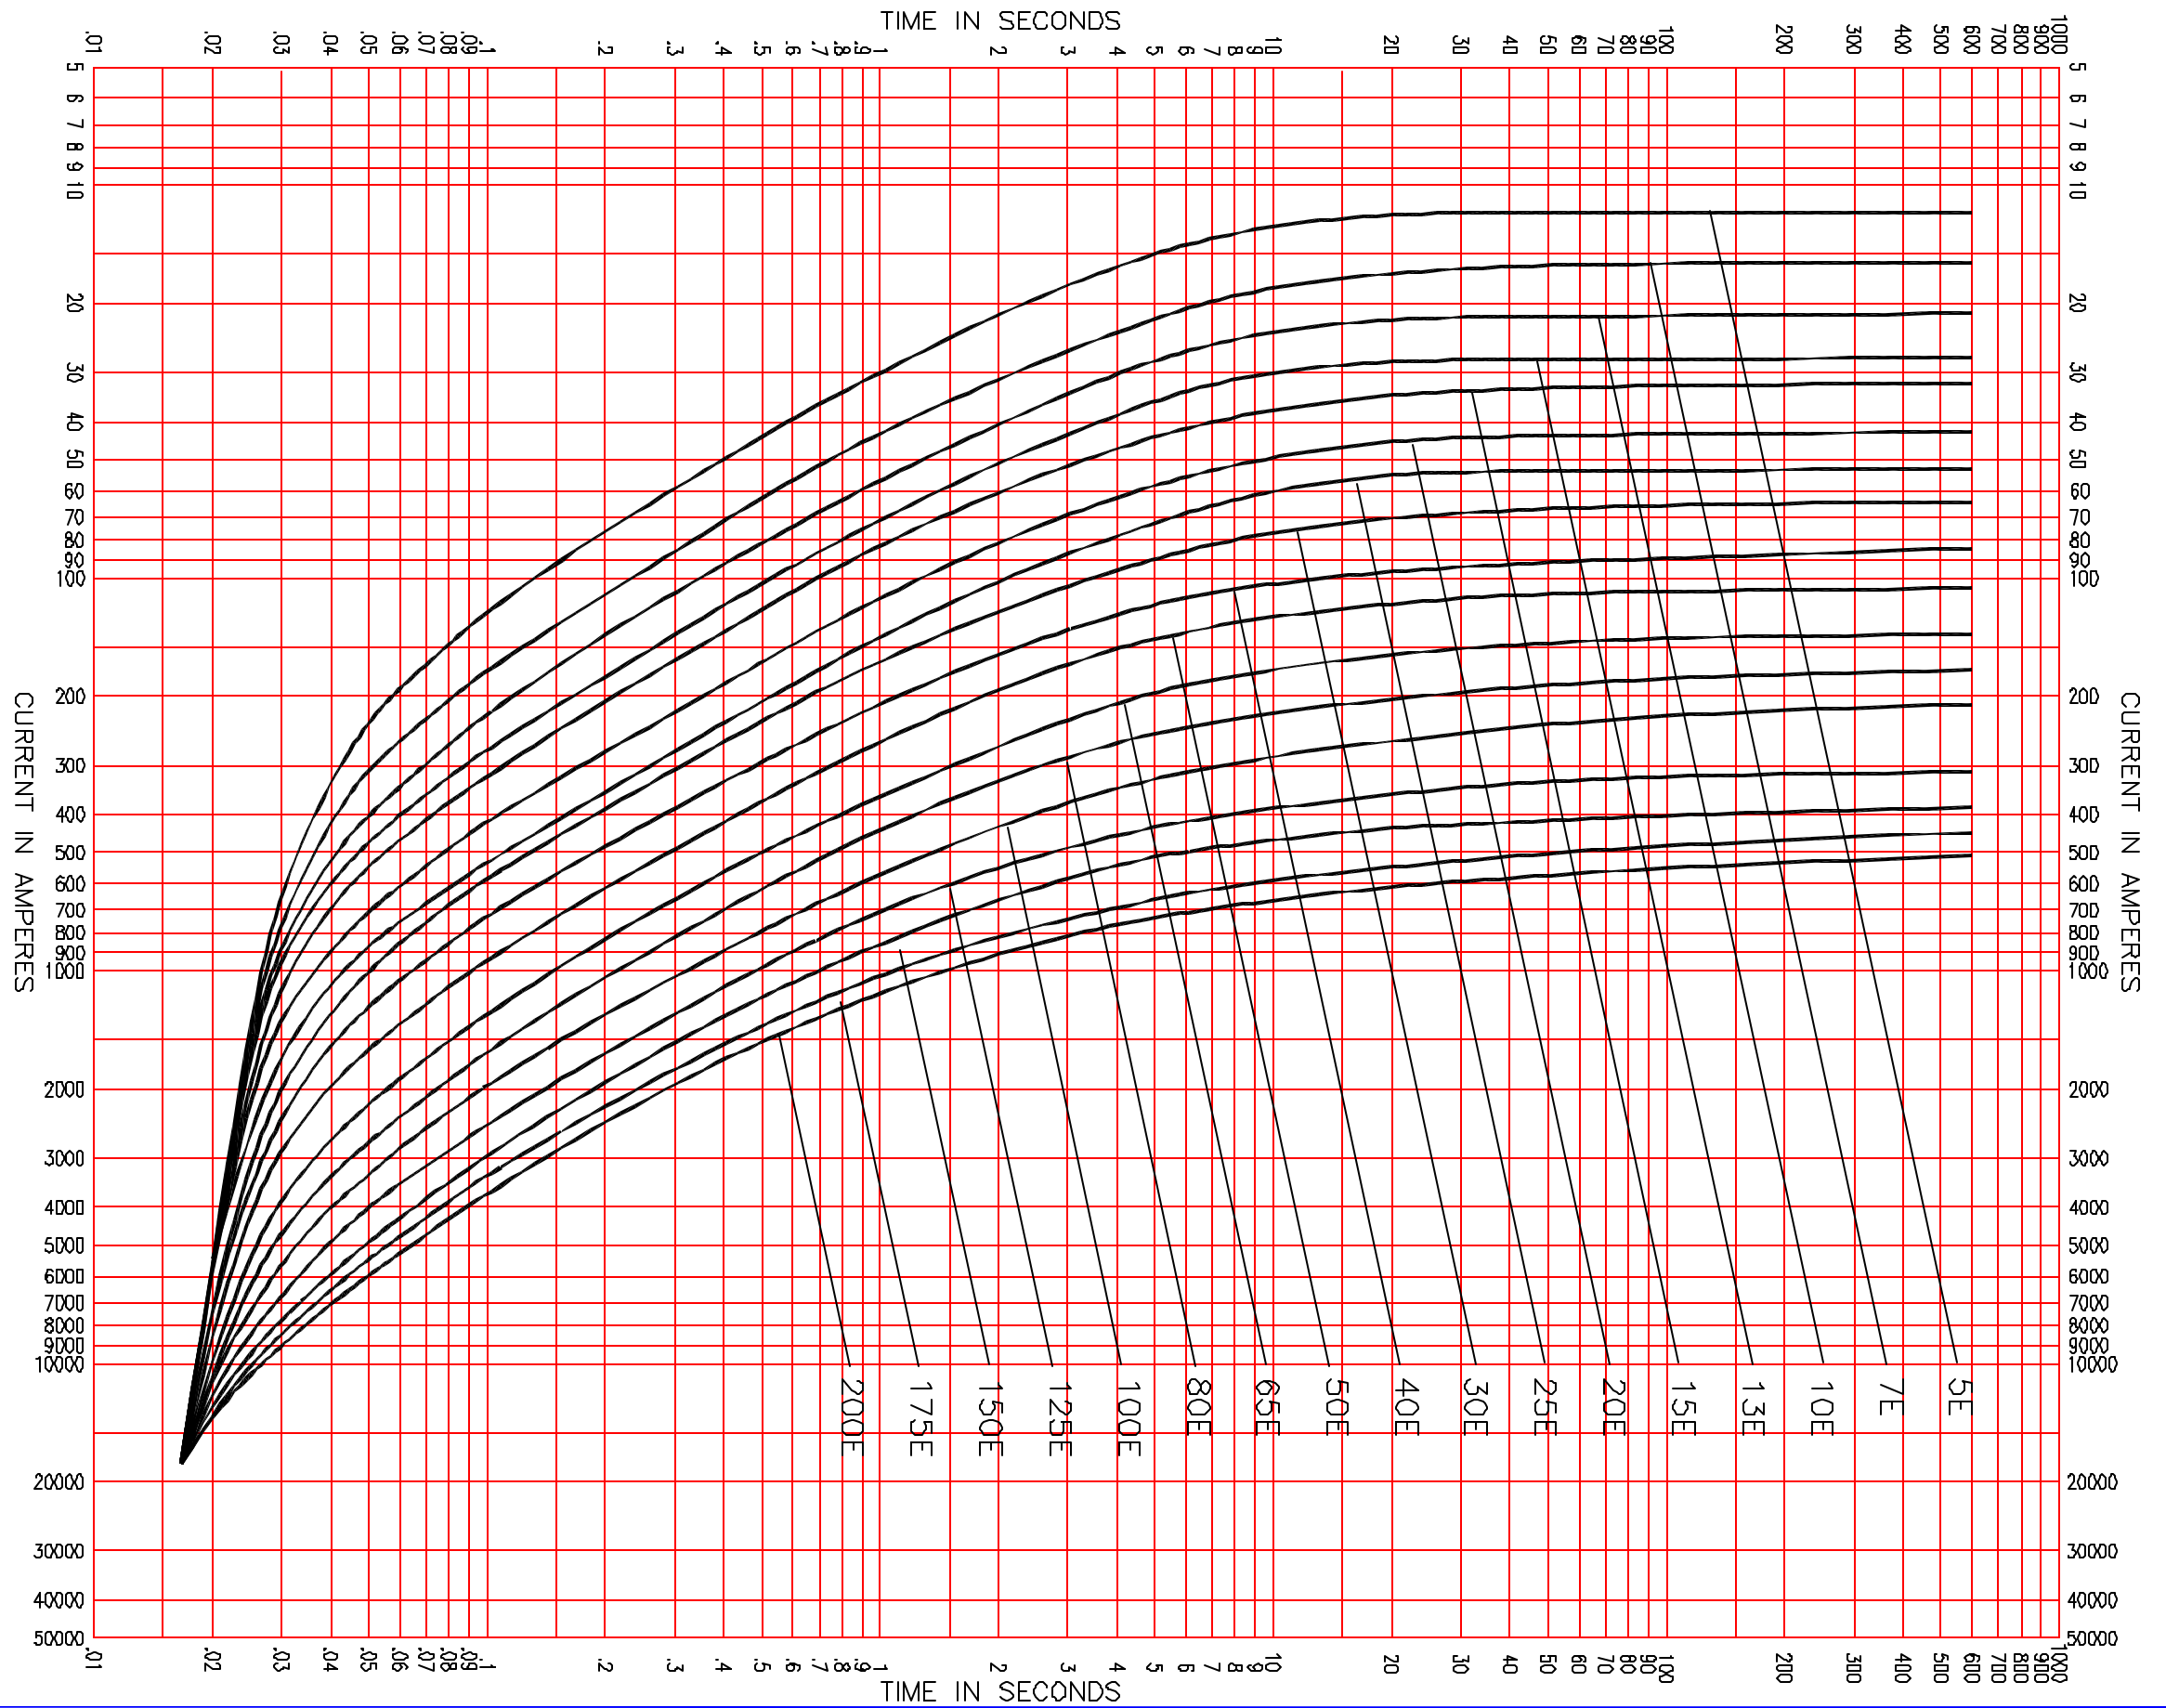

 COOPER Power Systems COMPONENTS AND PROTECTIVE EQUIPMENT					TIME—CURRENT CHARACTERISTICS CURVES				
DRAWN BY		CSR			CHK'D		17KV TOTAL CLEAR STANDARD E SPEED CMU 612XXX FUSES		
DATE		03/24/05		DATE		Tests made at HIGH Volts ac at LOW pf at 25°C with no initial load			
REPLACES		06/01		REV		02		Standards used as basis for data: IEEE C37.41–1994 & ANSI C37.46–1981(R1992)	
				REQ NO.		MAXIMUM TEST POINTS PLOTTED SO VARIATIONS SHOULD BE MINUS			
DWG NO.		42		39832		B		00	
THIS DRAWING WAS PRODUCED ON A CAD SYSTEM, ANY MANUAL REVISION WILL VOID IT.									