



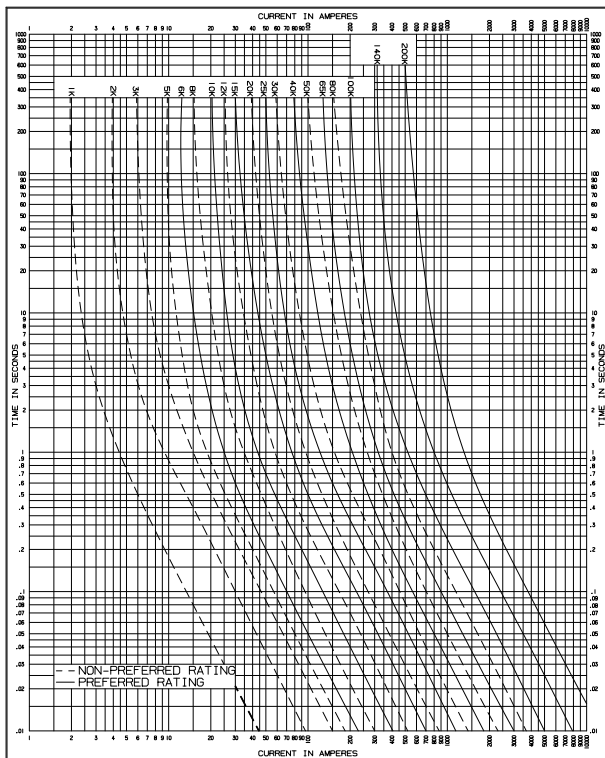

Reference Data
R240-91-1
Page 1 of 2

COOPER Power Systems COMPONENTS AND PROTECTIVE EQUIPMENT		TIME-CURRENT CHARACTERISTIC CURVES MINIMUM MELT FOR TYPE EEI-NEMA TYPE K-TIN	
DRAWN BY JFR DATE 7-11-00 REPLACES 04/85 REV 00 DWG NO. 42 39634 B 00	CHKD DATE REV 00 REG NO. 19892	Tests made at LOW Volts ac at HIGH pf at 25°C with no initial load Standards used as basis for data: ANSI C37.47-1981 (R1992) MINIMUM TEST POINTS PLOTTED SO VARIATIONS SHOULD BE PLUS THIS DRAWING WAS PRODUCED ON A CAD SYSTEM, ANY MANUAL REVISION WILL VOID IT.	

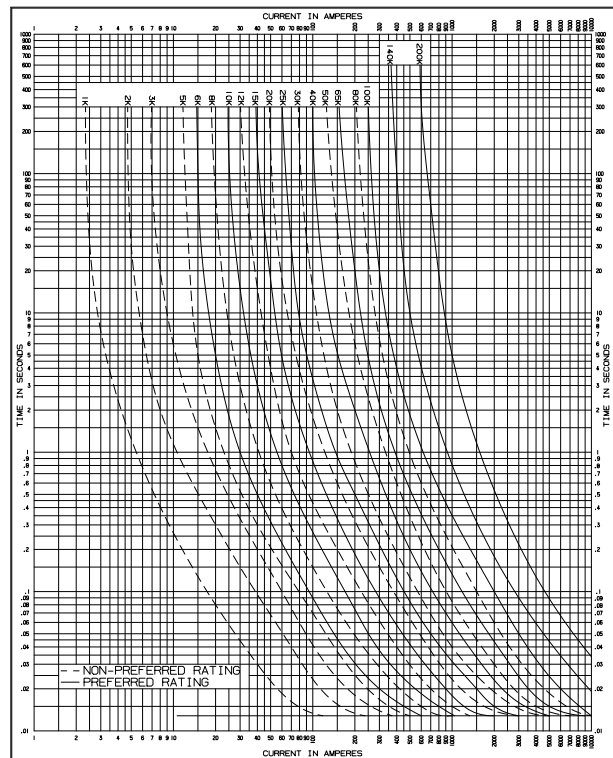

Reference Data
R240-91-1
Page 2 of 2

COOPER Power Systems COMPONENTS AND PROTECTIVE EQUIPMENT		TIME-CURRENT CHARACTERISTIC CURVES MAXIMUM CLEAR FOR TYPE EEI-NEMA TYPE K-TIN	
DRAWN BY JFR DATE 7-11-00 REPLACES 04/85 REV 00 DWG NO. 42 39634 B 00	CHKD DATE REV 00 REG NO. 19892	Tests made at LOW Volts ac at HIGH pf at 25°C with no initial load Standards used as basis for data: ANSI C37.47-1981 (R1992) MINIMUM TEST POINTS PLOTTED SO VARIATIONS SHOULD BE MINUS THIS DRAWING WAS PRODUCED ON A CAD SYSTEM, ANY MANUAL REVISION WILL VOID IT.	