

COOPER POWER SYSTEMS DIVISION
COMPONENTS & PROTECTIVE EQUIPMENT

TIME-CURRENT CHARACTERISTIC CURVES

MINIMUM MELT TIME-CURRENT CHARACTERISITC CURVES
8.3, 15.5 & 23kV X-LIMITER FULL RANGE PARALLEL MOUNTED FUSE

DRAWN BY **RJC** CHK'D

Tests made at RATED Volts ac at LOW pf at 25°C with no initial load

DATE **1-15-96** DATE

Standards used as basis for data: ANSI C37.47-1981


REPLACES **5/88** REV **01** REQ. NO.


MINIMUM TEST POINTS PLOTTED 50 VARIATIONS SHOULD BE PLUS

DWG NO. **TCC304 M**

THIS DRAWING WAS PRODUCED ON A CAD SYSTEM, ANY MANUAL REVISION WILL VOID IT.

Reference Data
R240-91-110
Page 1

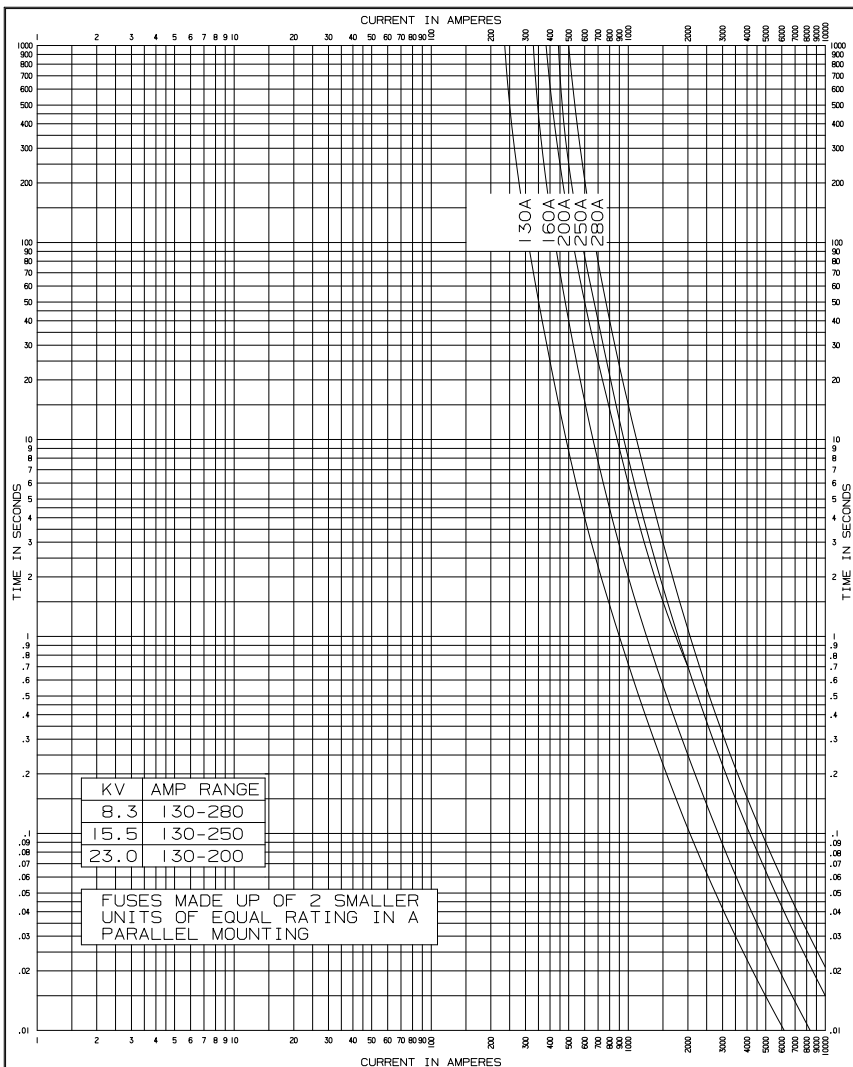

 COOPER POWER SYSTEMS DIVISION COMPONENTS & PROTECTIVE EQUIPMENT		TIME-CURRENT CHARACTERISTIC CURVES	
		MAXIMUM CLEAR TIME-CURRENT CHARACTERISTIC CURVES 8.3, 15.5 & 23kV X-LIMITER FULL RANGE PARALLEL MOUNTED FUSE	
DRAWN BY	RJC	CHK'D	
DATE	1-15-96	DATE	
REPLACES	5/88 REV 01	REQ. NO.	
DWG NO.	TCC304 C	THIS DRAWING WAS PRODUCED ON A CAD SYSTEM, ANY MANUAL REVISION WILL VOID IT.	