
 COOPER POWER SYSTEMS DIVISION COMPONENTS & PROTECTIVE EQUIPMENT		TIME-CURRENT CHARACTERISTIC CURVES	
		MINIMUM MELT TIME-CURRENT CHARACTERISITC CURVES 8.3, 15.5 & 23 kV X-LIMITER FULL RANGE "E" RATED FUSE	
DRAWN BY	RJC	CHK'D	
DATE	1-17-96	DATE	
REPLACES	11/87	REV	01
REQ. NO.		Tests made at RATED Volts ac at LOW pf at 25°C with no initial load Standards used as basis for data: ANSI C37.47-1981 MINIMUM TEST POINTS PLOTTED 50 VARIATIONS SHOULD BE PLUS	
DWG NO.		TCC200 M	
THIS DRAWING WAS PRODUCED ON A CAD SYSTEM, ANY MANUAL REVISION WILL VOID IT.			

Reference Date
 R240-91-130
 Page 1

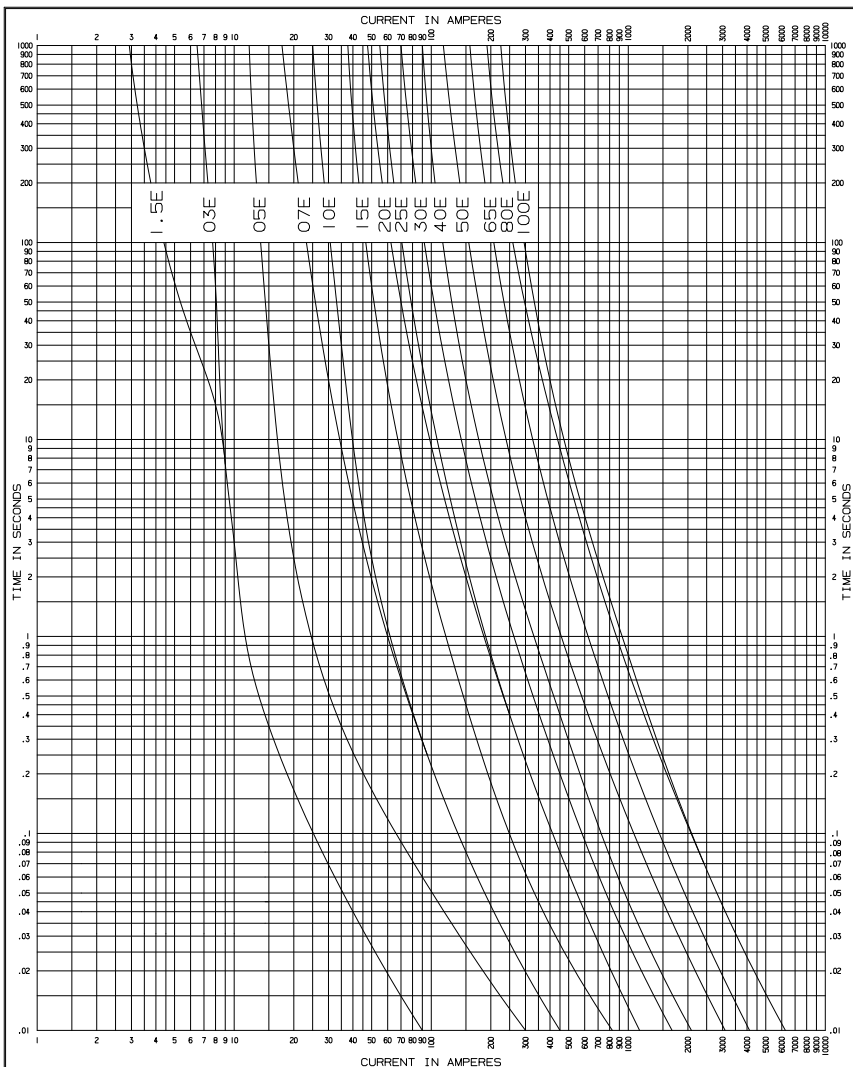

 COOPER POWER SYSTEMS DIVISION COMPONENTS & PROTECTIVE EQUIPMENT		TIME-CURRENT CHARACTERISTIC CURVES	
		MAXIMUM CLEAR TIME-CURRENT CHARACTERISTIC CURVES 8.3, 15.5 & 23 kV X-LIMITER FULL RANGE "E" RATED FUSE	
DRAWN BY	RJC	CHK'D	Tests made at RATED Volts ac at LOW pf at 25°C with no initial load
DATE	1-17-96	DATE	Standards used as basis for data: ANSI C37.47-1981
REPLACES	11/87	REV	01
REQ. NO.			MAXIMUM TEST POINTS PLOTTED 50 VARIATIONS SHOULD BE MINUS
DWG NO.	TCC200	C	THIS DRAWING WAS PRODUCED ON A CAD SYSTEM, ANY MANUAL REVISION WILL VOID IT.