


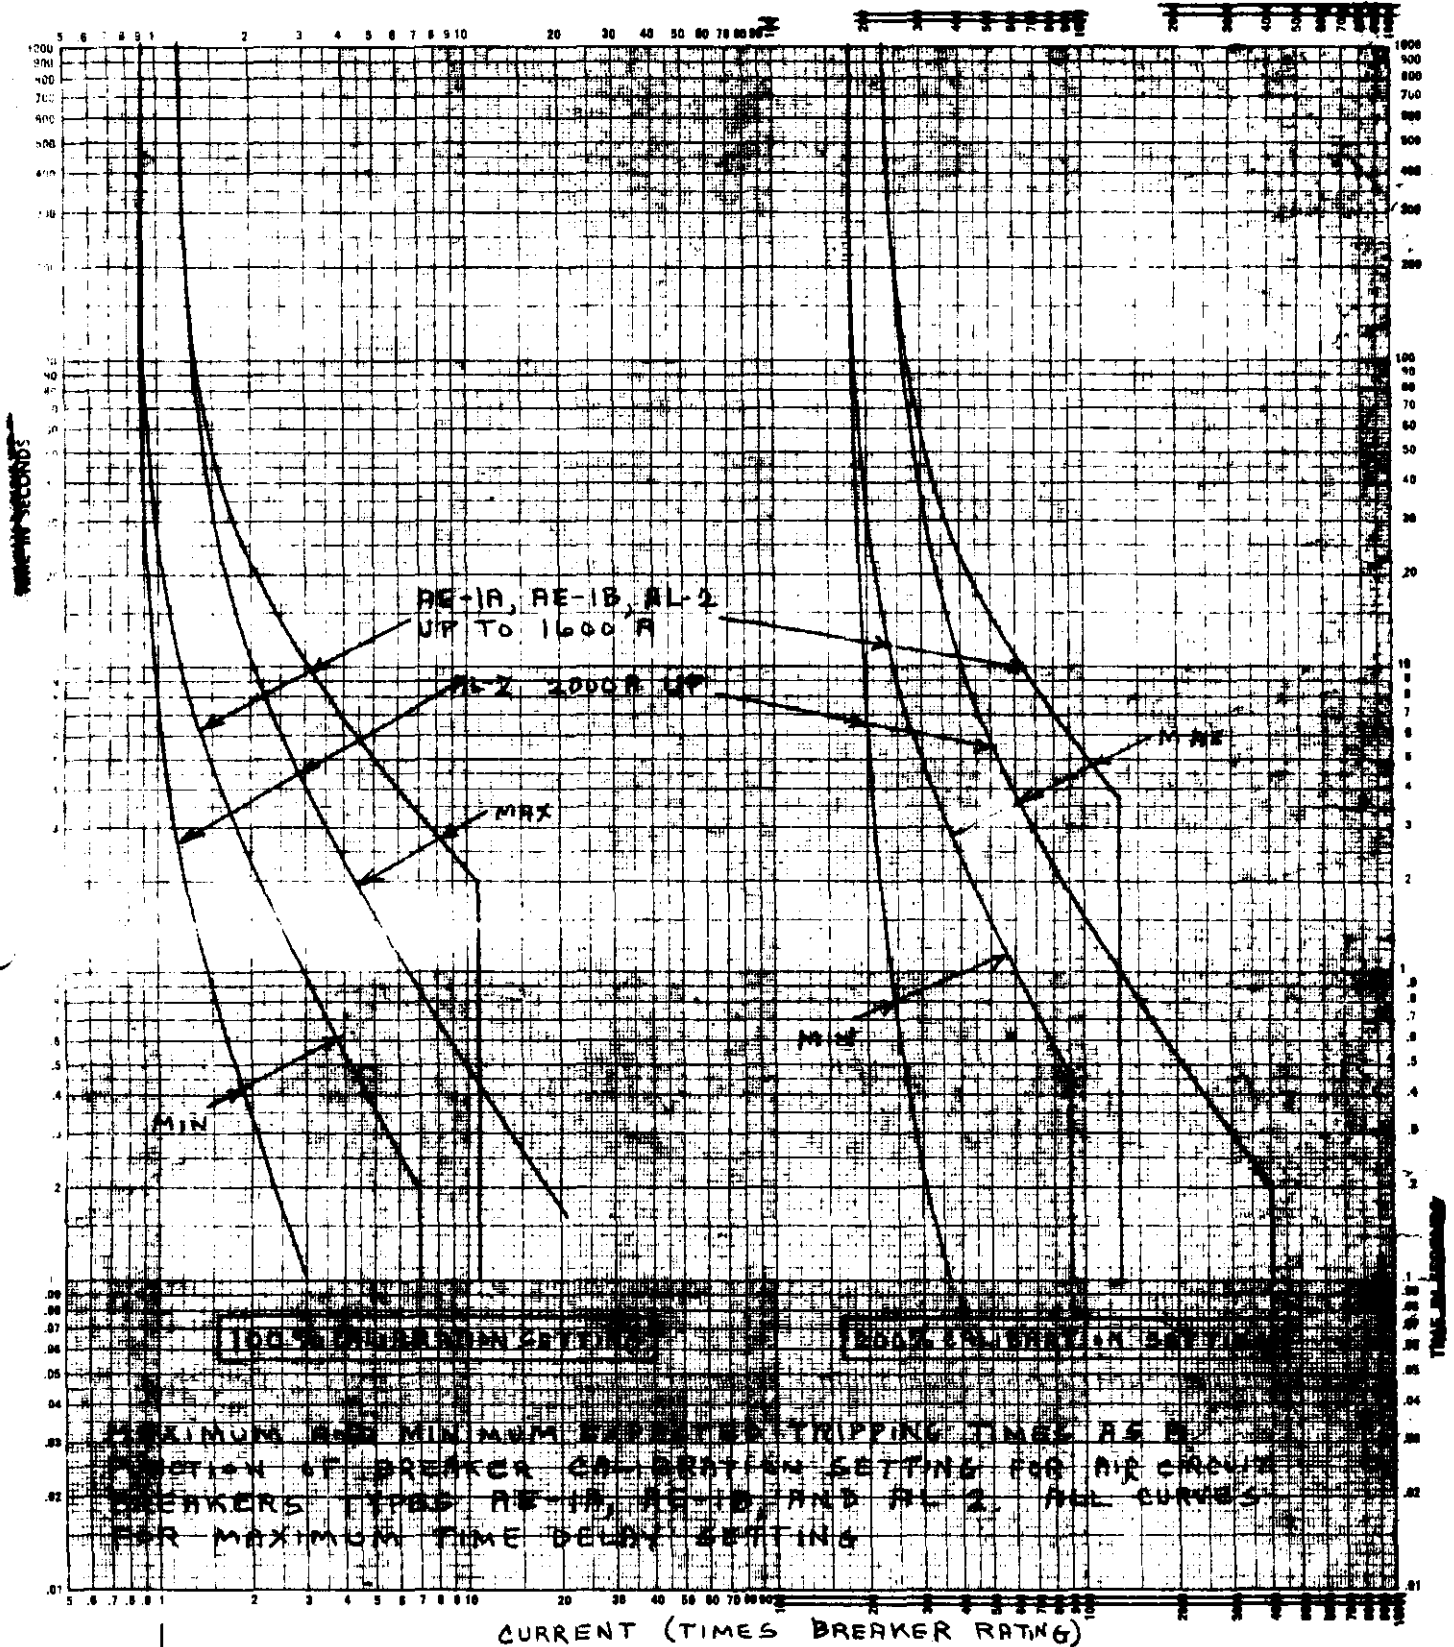

GENERAL ELECTRIC

# TIME-CURRENT CURVES

NO. 0127 B 7224

REQUISITION NO. REFERENCE

PROPOSED FOR: RE-1A, RE-1B, AL-2

COPY OF ORIGINALS H-6080917, H-6080922 INSPECTED MAY 29, 1963

COMPONENT LOW VOLTAGE SWITCHGEAR DEPT.

REDATE JUNE 4, 1963

PHILADELPHIA 42, PA.

Low Voltage Power Circuit Breakers equipped with adjustable trip devices are rated at 100% of the continuous current rating of the trip coil. Trip device pick-up for coordination purposes but current rating of the circuit breaker is not to be increased.

RE DRAWN BY ZCH/ffr