


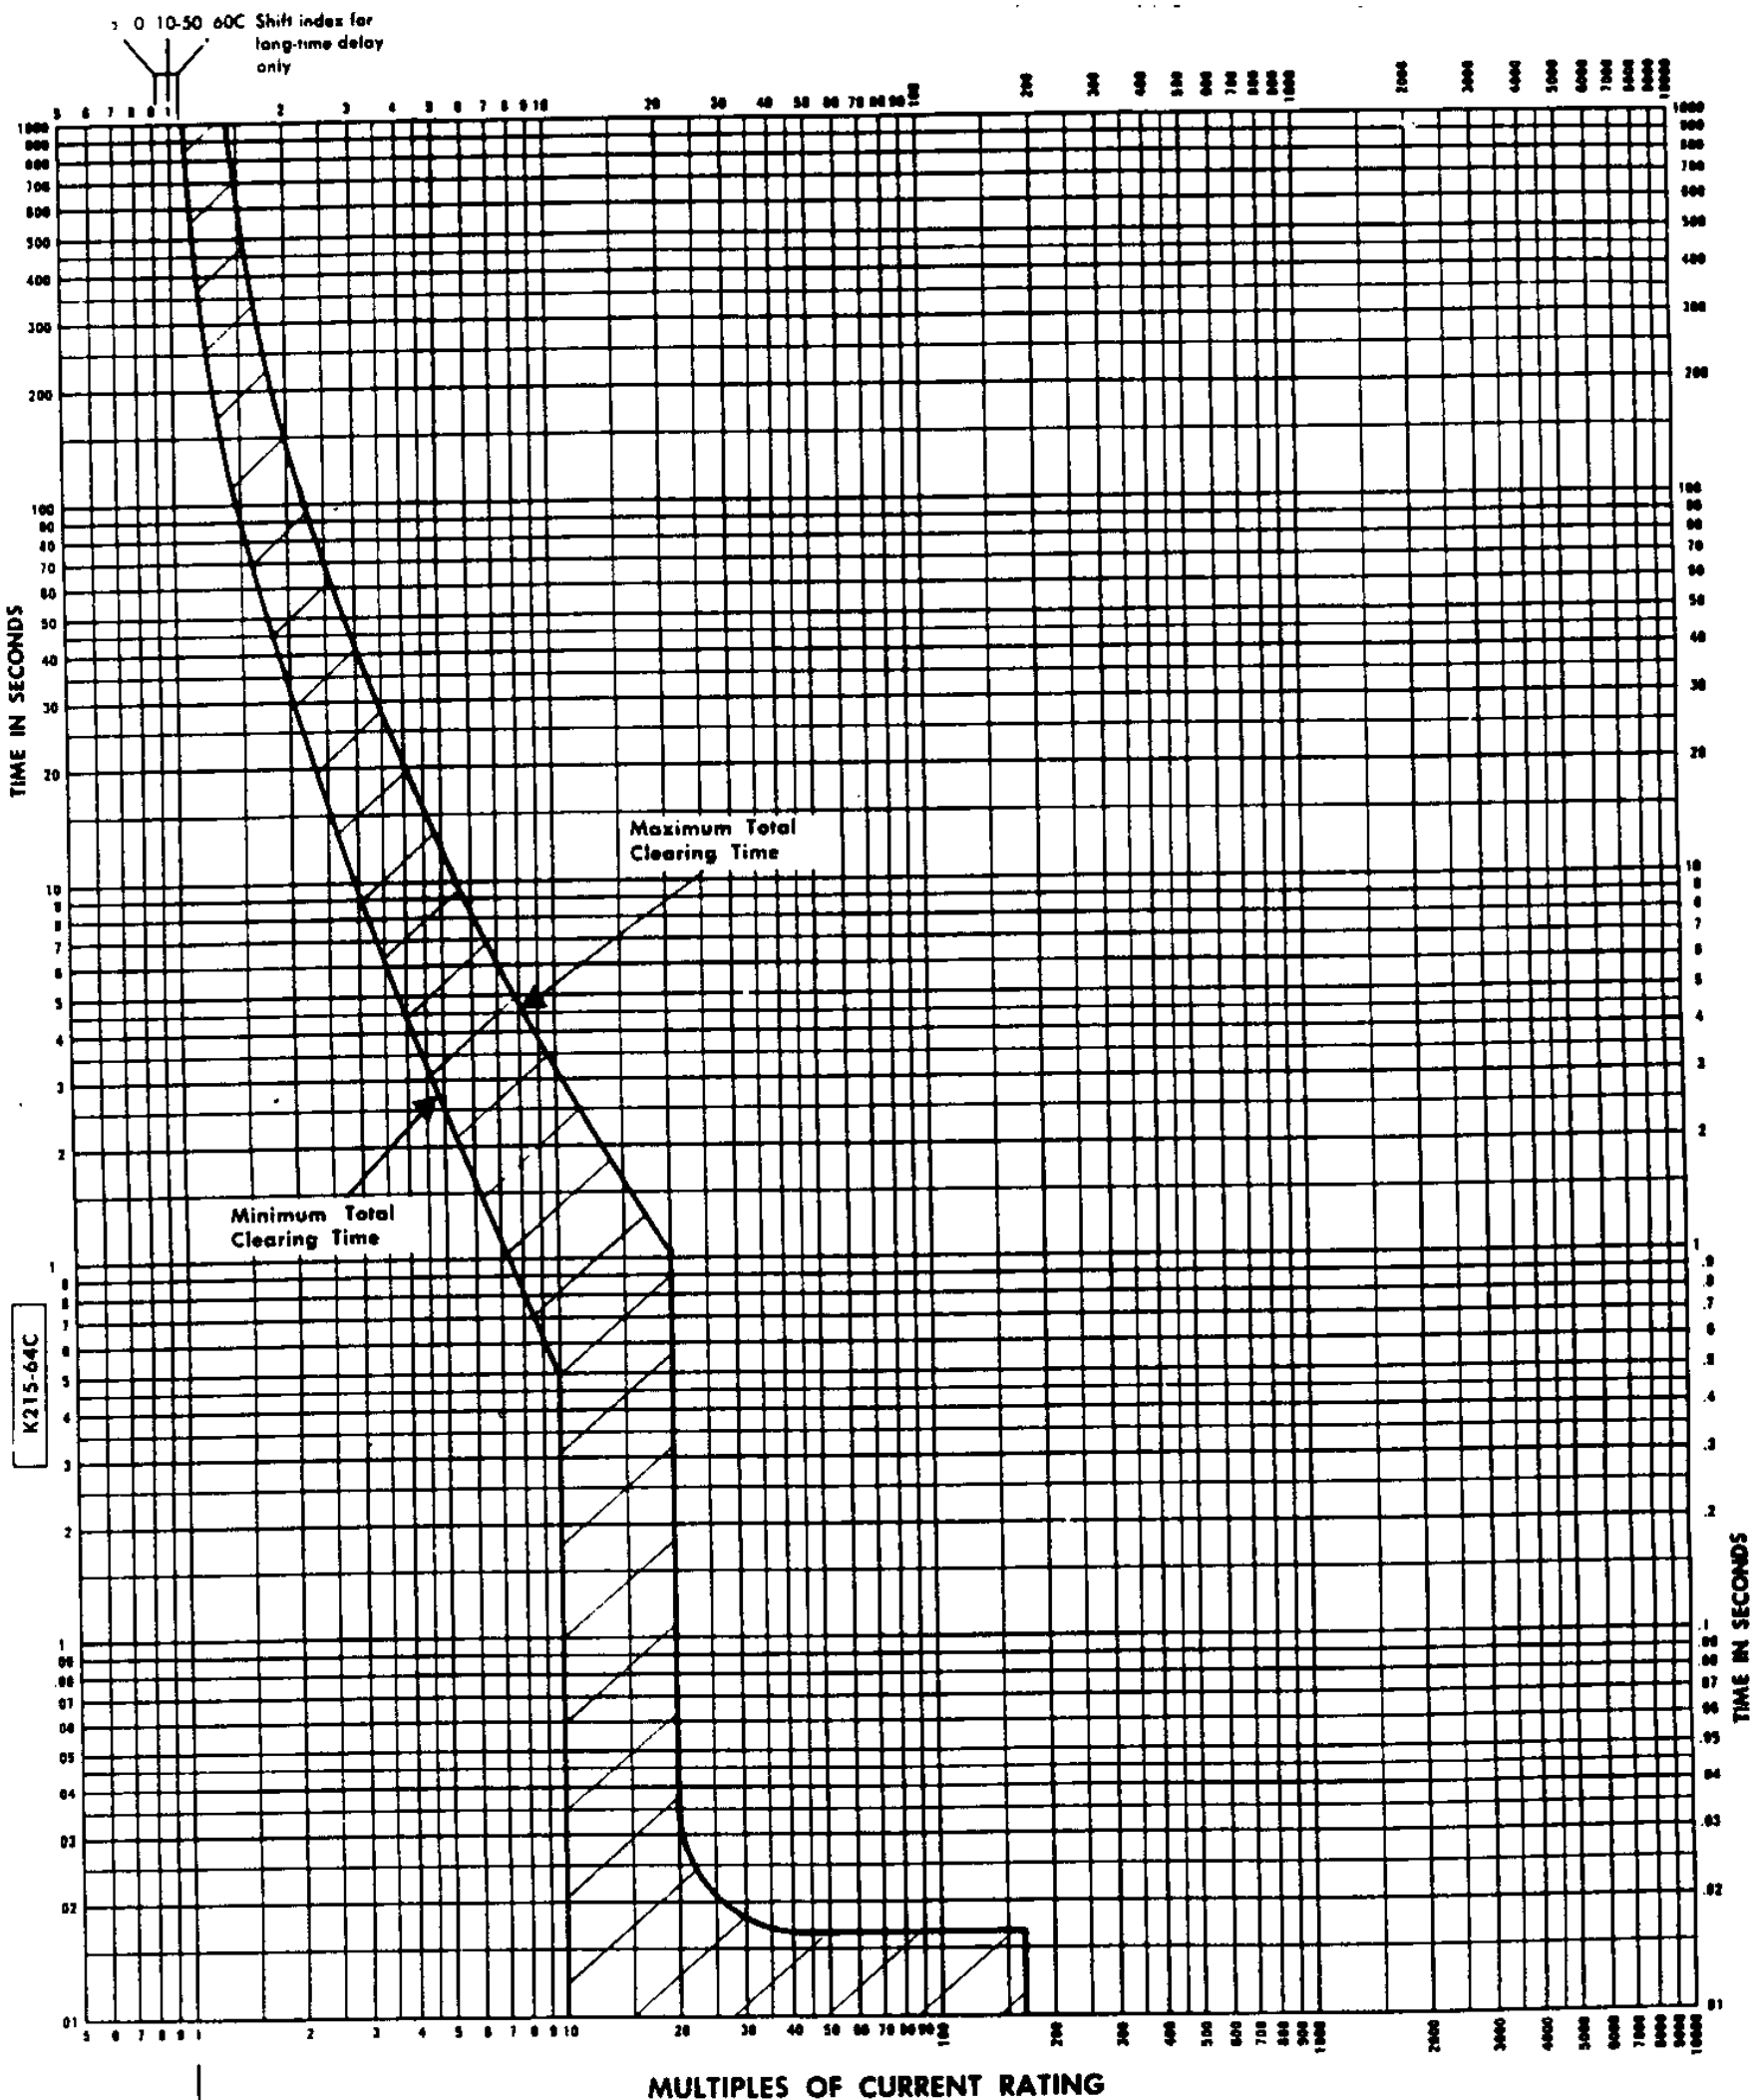

GENERAL ELECTRIC

Current Ratings
2 and 3 Pole—60, 70, 90 and 100 Amperes
1 Pole—60 and 70 Amperes
Voltage Ratings
1 and 2 Pole—120/240 Volts, A-c
2 and 3 Pole—240 Volts, A-c
Frequency Rating
60 Cycles

MOLDED-CASE CIRCUIT BREAKER

"Q" LINE

AMBIENT COMPENSATED
Types TQAL-AC, THQAL-AC, TQB, THQB, TQC & THQC
Long-time Delay and Instantaneous Time-current Curve

(Curves show circuit breaker in open air, 10-50C ambient, wired with conductors of corresponding rating, no prior load. For all other ambients use rating shift index at top of sheet.)

K215-64C

Adjustments

Long-time delay thermal trip: not adjustable ✓
Instantaneous magnetic trip: not adjustable

CIRCUIT PROTECTIVE DEVICE, DEPARTMENT PLAINVILLE, CONNECTICUT