

LLOYD GRANT - FB.80 - S/N. 60-147 - 8/60 *Spd* 3/13/89

REVISIONS				TOOL NUMBERS	

WIRING DIAGRAM
 DRAWING - FB 80 1 POLE - NEGATIVE DISCONNECT (TWO POLE CONTRA-2 FRAME)
 BLOC OPER. WITH OVERT TRIP - 16 AUXILIARY SW. CONTACTS TOTAL D.C. CONTROL

DATE *8/26/60* THE DATE *8/26/60* APP. *WJS* SCALE *1*
 DATE *May 23, 1960* DATE *May 24, 1960* DATE *May 24, 1960*
 B.L. 35558 1-T-E CIRCUIT BREAKER CO. 188219
 PHILADELPHIA, PENN., U.S.A. SHEET 1 OF 2 REV. 0

REPLACED BY NO. 189084 (SHEET 1 IS A 4 1/2 SIZE)

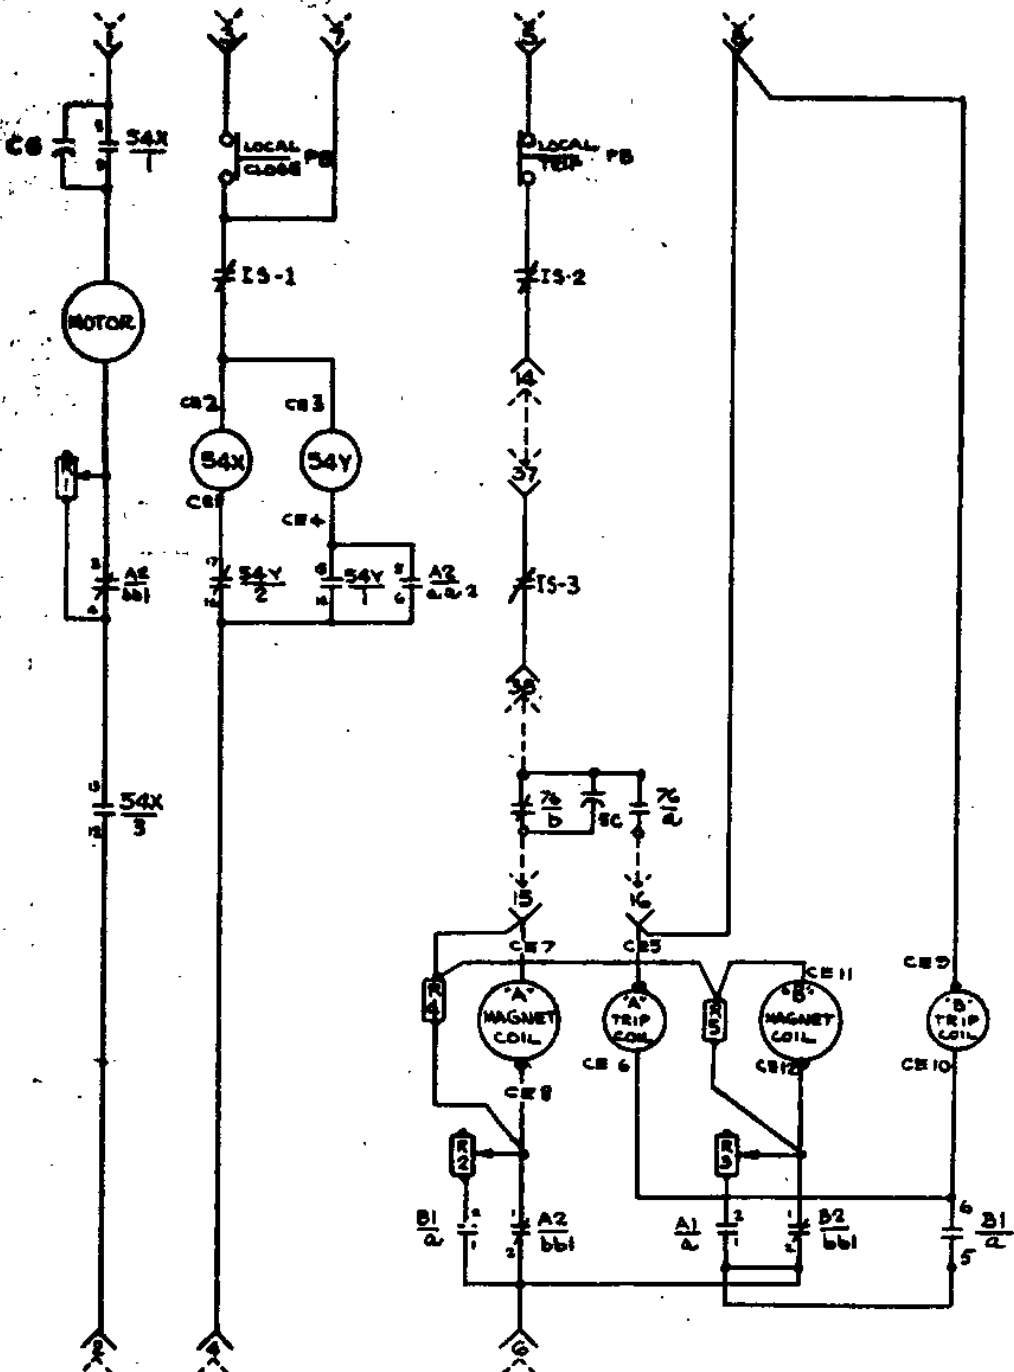


TABLE 1

ITEM	IF DIRECTION OF CURRENT FLOW TO TRIP BREAKER IS -	
	ARROW	POLARITY CONNECTIONS:
A	LINE LOAD	As Shown
B	LINE LOAD	Reverse - CE 5 & CE 6 CE 9 & CE 10 CE 7 & CE 8 CE 11 & CE 12

REFER TO 187883 FOR SEQUENCE OF OPERATIONS AND LEGEND.

EXTRA AUXILIARY SWITCH CONTACTS WIRED OUT.

